


NOTE:
Confirm location of existing underground electrical cables prior to commencing construction of the water main.

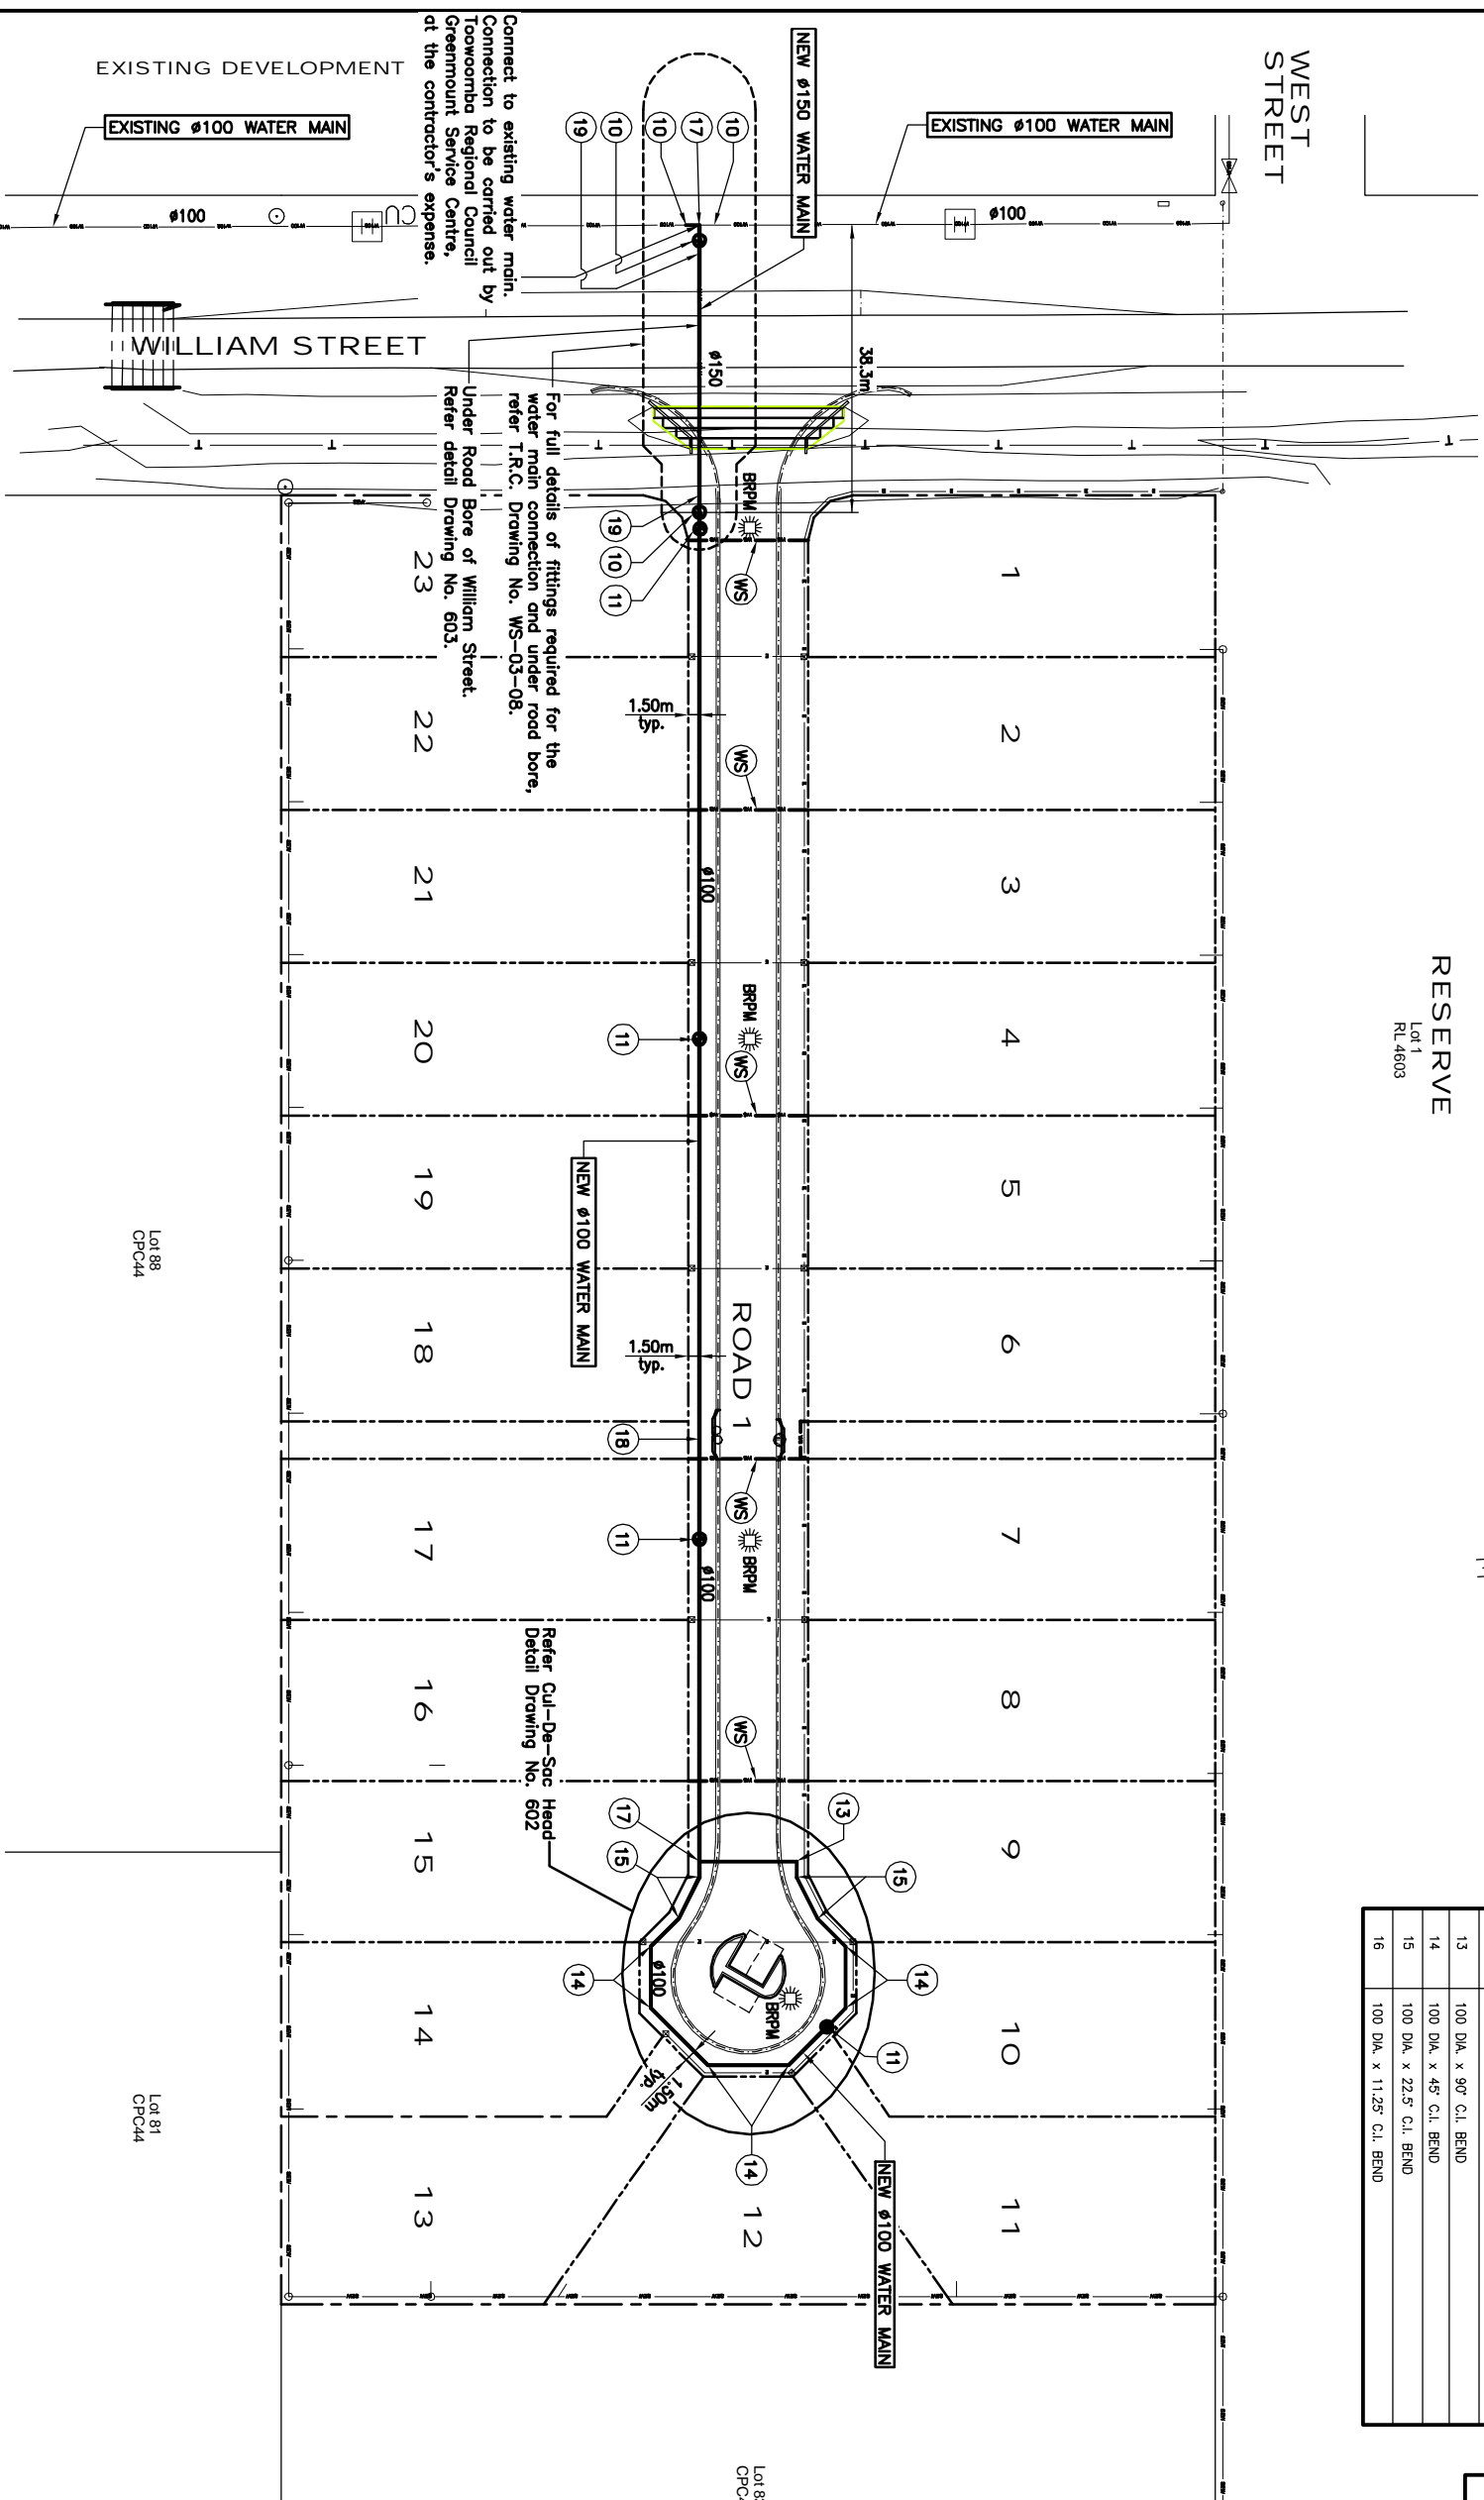

RESERVE
Lot 1
RL 4603



TABLE OF FITTINGS:

FITTING No.	DESCRIPTION.
100 DIA	
10	100 DIA. SLUCE VALVE, VALVE BOX & MARKER PLATE
11	100 / 80 DIA. FIRE HYDRANT TEE, 80 DIA. HYDRANT RISER, 80 DIA. SPRING HYDRANT, HYDRANT BOX & BRPM MARKER
12	100 / 80 DIA. FLUSHING FIRE HYDRANT, HYDRANT RISER, 80 DIA. SPRING HYDRANT, HYDRANT BOX & BRPM MARKER
13	100 DIA. x 90° C.I. BEND
14	100 DIA. x 45° C.I. BEND
15	100 DIA. x 22.5° C.I. BEND
16	100 DIA. x 11.25° C.I. BEND

TABLE OF FITTINGS:

FITTING No.	DESCRIPTION.
100 DIA	
17	100 x 100 x 100 C.I. TEE
18	SCOUR VALVE - 100 / 80 SCOUR TEE, 80 DIA. SLUCE VALVE, VALVE BOX, MARKER PLATE, 80 DIA. D.I. SCOUR PREWORK TO SAC PIT, COMPLETE IN PLACE
19	150 TO 100 REDUCER
20	100 DIA. GIBBULT

NOTES
Refer to Drawing No. 602 for Water Reticulation Notes

LEGEND

- New Sewer Gravity Main
- New Rootwater Line
- New Enveloper Conduit
- New 100mm & 150mm Water Main
- Existing Water Main
- Existing Telstra
- New Electrical - Underground
- Electrical - Overhead
- Stormwater Drainage
- New Pavement

NOTES:
450mm UPVC Class 12 WATER SERVICE CONDUIT ENVELOPER PIPES TO SERVICE ALLOTMENTS. "M" MARKERS ON KERBS BOTH SIDES, AT EACH CROSSING.
BLUE RAISED REFLECTIVE PAVEMENT MARKER

WATER RETICULATION LAYOUT PLAN
Scale: - C

Revisions	Date
A Original issue	May 08
B For Construction	Aug 08
C T.R.C. water main connection	Oct 08

136 HERRIES STREET
PO BOX 1382
TOOWOOMBA
QLD 4350
PH.: 07 4638 5655
FAX.: 07 4638 3558
EMAIL: mri@bakerrossow.com.au

client	STYLCO PTY LTD
project	WILLIAM STREET, CAMBOOYA
title	WATER RETICULATION LAYOUT PLAN

Survey	Drawn	Design	J/M	Examined	Certified
HS	CMO	CMO	EGA	/	/
AUG 06	MAR 08	MAR 08	MAR 08		

DISCREPANCIES
WHERE ANY DISCREPANCY EXISTS BETWEEN FIGURED AND SCALED DIMENSIONS, THE FIGURED DIMENSIONS SHALL APPLY.

COPYRIGHT
COPYRIGHT EXISTS ON ALL PLANS & DESIGNS PRODUCED BY BAKER ROSSOW CONSULTING ENGINEERS AND SHALL NOT BE REPRODUCED IN PART OR IN FULL WITHOUT WRITTEN APPROVAL.

DIMENSIONS
THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, UNLESS OTHERWISE SPECIFIED, BEFORE COMMENCING ANY WORK ON SITE. IF ANY DOUBT EXISTS THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY BEFORE PROCEEDING WITH ANY WORK.

JOB No.	104000	No. of plans	
		Plan No.	601